

50.00

EHT = 15.00 kV

3/19/01 TRS-10 SP#9

Detector = SE1

Date :21 Mar 2001

Fig. 1 (“Prior Art”)

3/19/01 TRS-10 SP#6

Detector = SE1

Date :21 Mar 2001

20.0um

EHT = 15.00 kV

Fig. 2

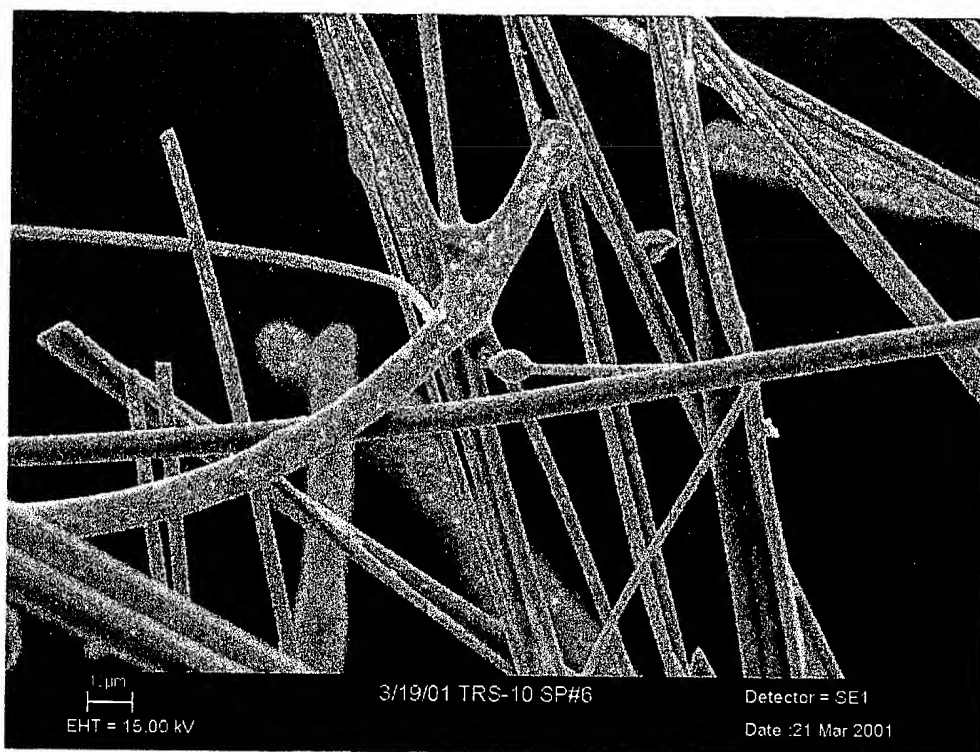


Fig. 3